

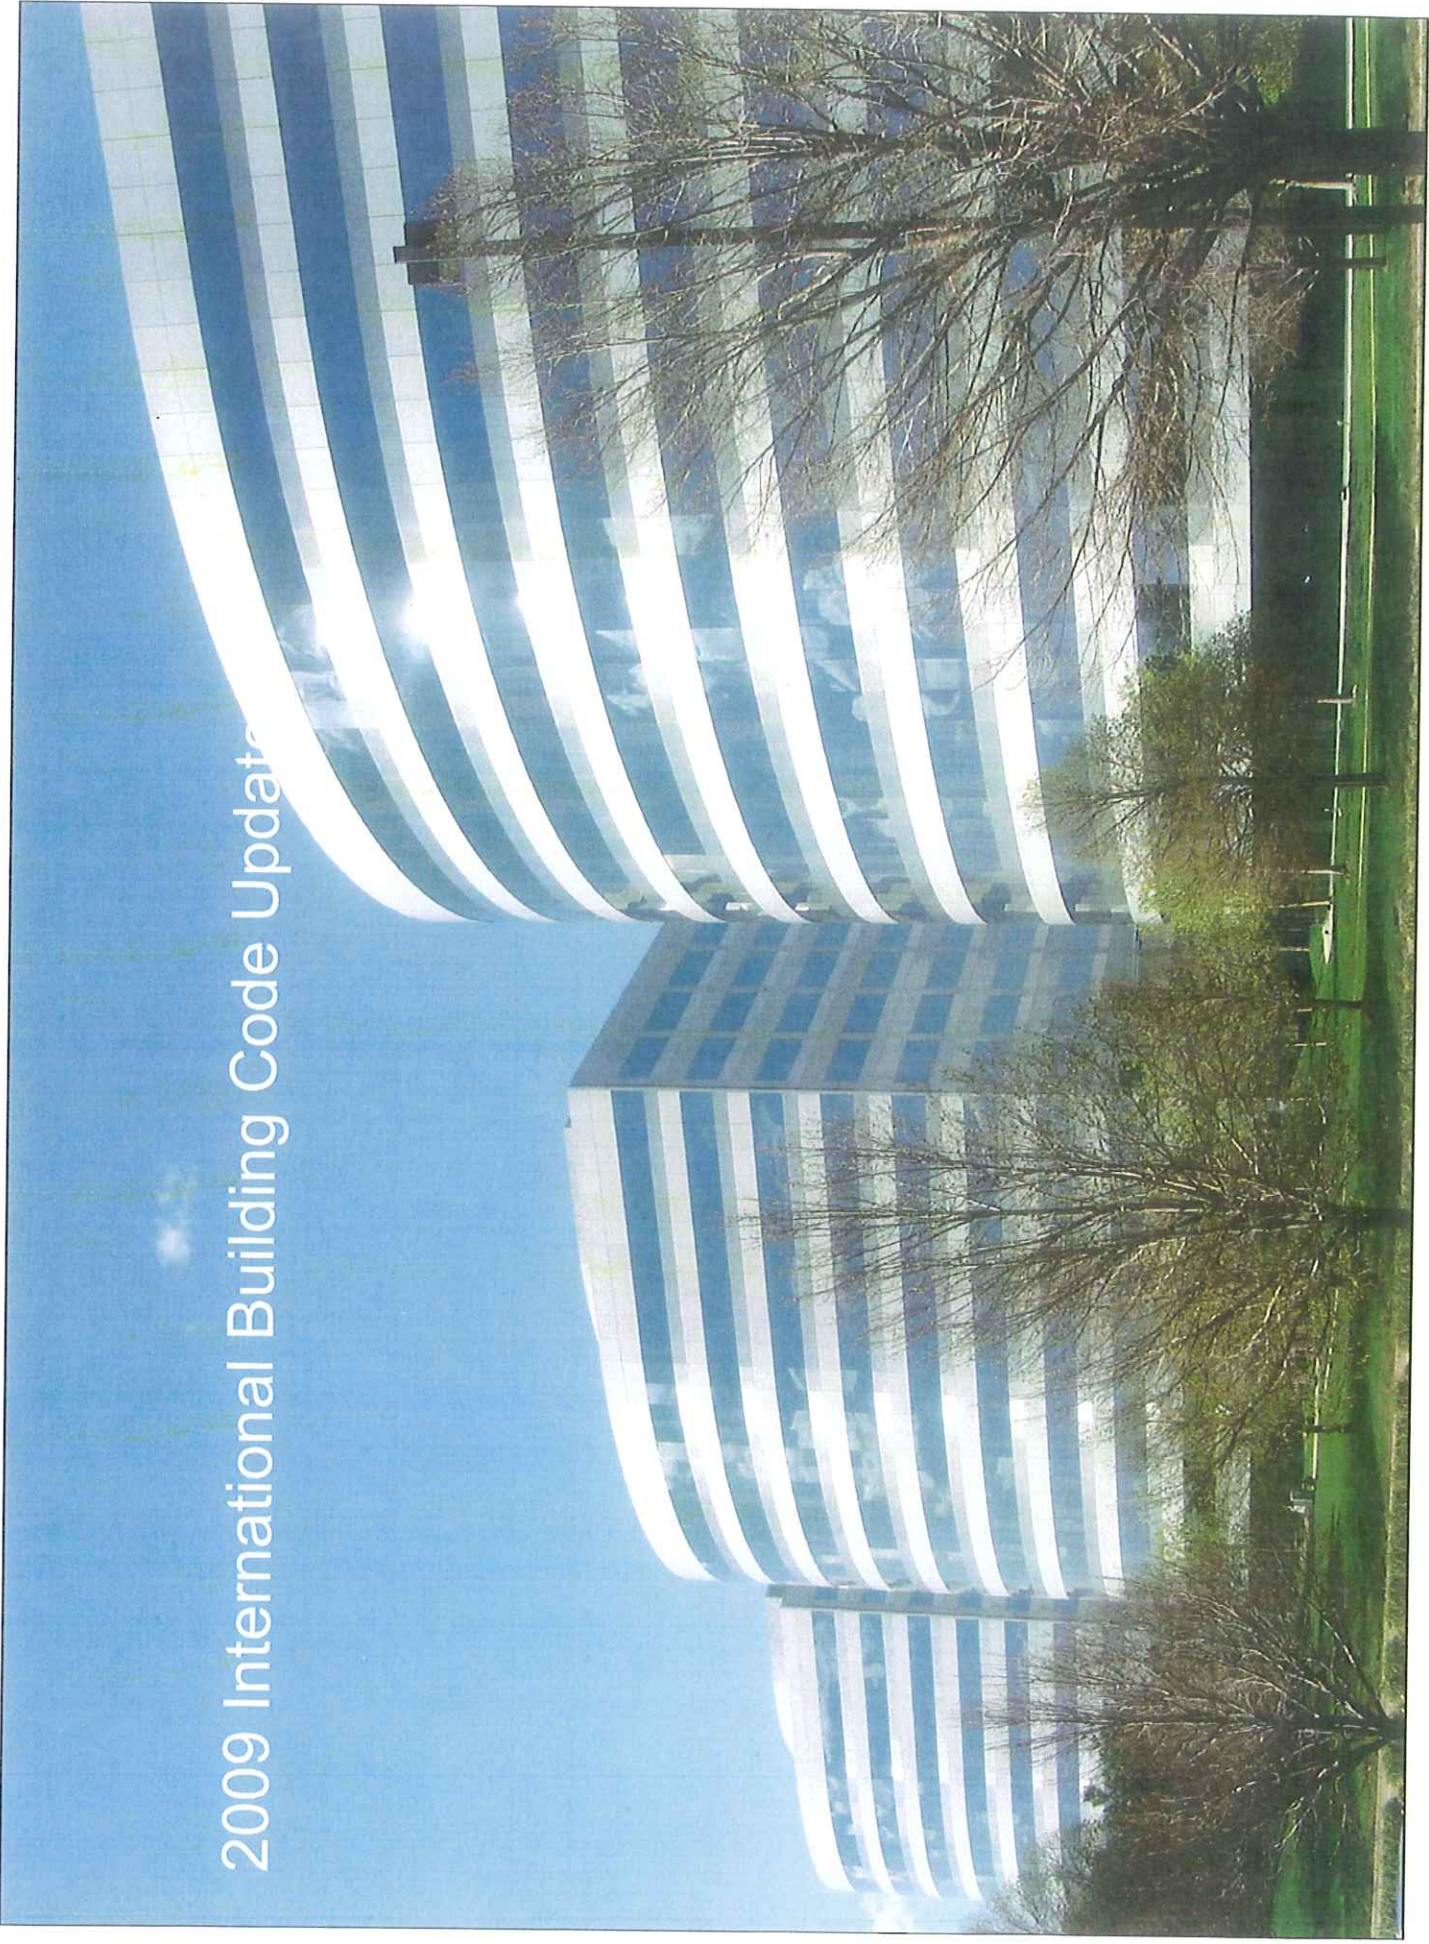


# 2009 International Building Code Update

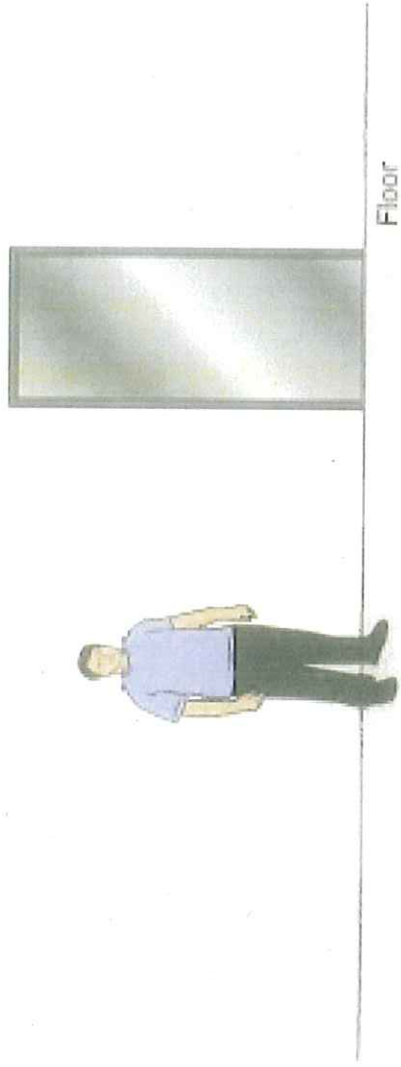

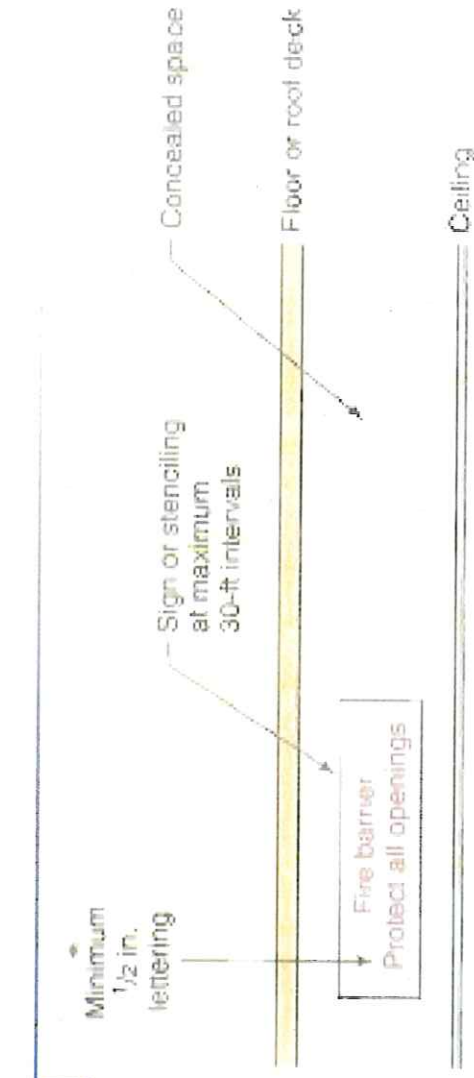

Identification sign for fire barrier

## 2009 International Building Code

Section 703.6 Marking and Identification of fire resistive construction

IBC section 1008.1.2, exception 9

In other than Group H occupancies, manually operated horizontal sliding doors are permitted in a means of egress from spaces with an occupant load of 10 or less.

IBC section 1008.1.9.4

Manually operated edge- or surface- mounted Bolts  
Exceptions 3, 4 and 5 will now allow them under certain conditions.

IBC section 1008.1.9.8

Electromagnetically Locked Egress Doors

Are now permitted in certain circumstances.



## **2009 International Energy Conservation Code (IECC)**

Under the 2006 International Energy Code existing building were exempt form regulation as adopted by the Village. That exemption will continue for the 2009 Code period.



## 2009 International Mechanical Code (IMC)

### Section 507.2.1 Type I Hoods

Type I hoods shall be installed where cooking appliances produce grease or smoke. Type I hoods shall be installed over *medium-duty, heavy-duty and extra-heavy-duty appliances*. Type I hoods shall be installed over *light-duty cooking appliances* that produce grease or smoke in quantities deemed to be hazardous, as determined by the Building Official.

### Section 504.6 Domestic Clothes Dryer Ducts

The length of dryer ducts has increased from 25 feet to 35 feet.



## **2009 International Plumbing Code (IPC)**

### **[IPC section 403.4.1 Directional Signage](#)**

This section has been deleted from the code adoption.



## 2009 International Fuel Gas Code

### IFGC section 404.4

Gas piping is not permitted to enter a foundation below grade.



Accessibility Standard remains the ICC/ANSI A117.1-2003

Electric Code remains the 2008 NEC until the State Electric Board adopts the 2011 NEC. (July 1 2011 adoption of the 2011 code)

Elevator Code remains the ASME A17.1-2007 until such time as the State requirement changes.



## 2009 International Fire Code (IFC)

### Section 4604.23 Egress Path Markings

Existing Buildings of Groups A, B, E, I, M, and R-1 having occupied floors located more than 75 feet above the lowest level of fire department vehicle access shall be provided with luminous egress path markings in accordance with Section 1024.